

JPR5-176

JAIPUR VIDYUT VITRAN NIGAM LIMITED  
(Office of the Chief Engineer Commercial & Planning)

No.JP Discom/Dy.CE/C.I/F.4(210)/Pt.V/D. 67 Dt. 12.04.04

ORDER

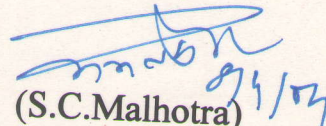
Sub : Prescribing norms for electrification of colonies to be  
Developed by private builders and others.

The matter of prescribing norms for electrification of colonies to be developed by various agencies was again discussed in 69<sup>th</sup> meeting of the Coordination Committee held on 31-3-04 and 1-4-04. After detailed discussions, it was decided that the Item No. (1) of the order No. 340 dt. 27-2-04 (JPR5-162) be substituted by the following: -

(1) "The assessed connected load shall be calculated @ 5 KW per 1000 Sq. feet of plot area. However, for working out the capacity of the transformer cables and allied equipments, the designed load be taken @ 60% of assessed connected load."

Other terms & conditions of the order No. JPR5-162 dt. 27-2-04 shall remain unchanged.

By order,

  
(S.C. Malhotra)

Dy. Chief Engineer (C&P)

68