


COMPOUND WALL GATE FOR 220/132 KV GSS

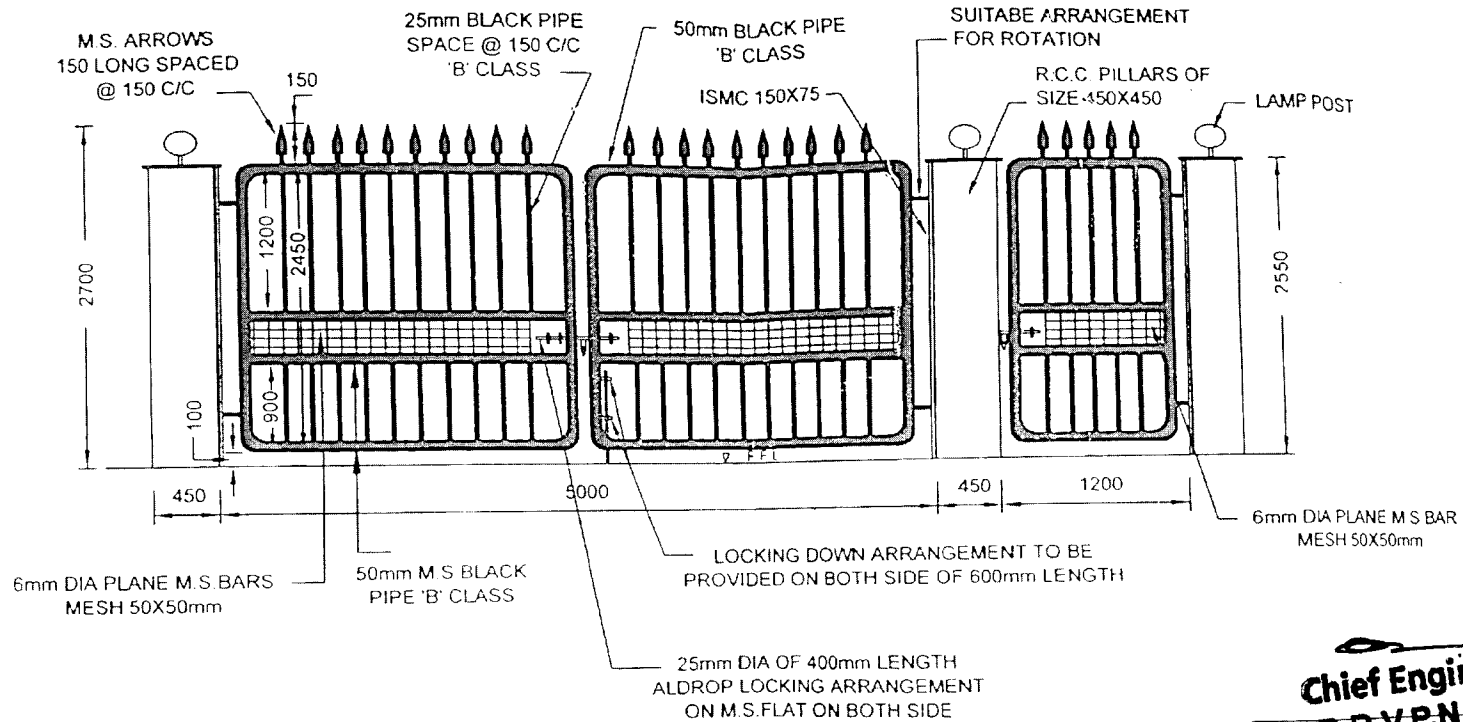

- NOTE:-
1. ALL DIMENSIONS ARE WRITTEN IN mm.
 2. DRAWING NOT TO BE MEASURED . ONLY WRITTEN DIMENSIONS ARE TO BE FOLLOWED.
 3. IN CASE OF ANY DISCREPANCY , THE DRAWING BE REFERRED TO THIS OFFICE FOR SEEKING CLARIFICATION
 4. FOR COLONY WIDTH OF MAIN GATE BE KEPT 4000mm WHILE WICKET GATE DIMENSIONS WOULD REMAIN SAME.
 5. THE HEIGHT OF GATE SHALL BE KEPT 3150mm IN PLACE OF 2700mm FOR 220 KV GSS AT DISTT. H.Q.

Chief Engineer (Civil) R.R.V.P.N.L., JAIPUR		
OFFICE OF THE CHIEF ENGINEER (CIVIL) R.R.V.P.N.LTD, JAIPUR		
COMPOUND WALL GATE FOR 220/132 KV GSS		
DRAWN BY: <i>[Signature]</i> (O.P. PAREEN) DMM-2	CHECKED BY: <i>[Signature]</i> AENIC-DESIGN	DRG NO. SCALE: N.T.S. DATE:
SUBMITTED BY: <i>[Signature]</i> AENIC-DESIGN		APPROVED BY: <i>[Signature]</i> CHIEF ENGINEER (CIVIL)