


APPENDIX - I (A)

NOTE :

- (1) BILL OF MATERIAL AS PER OUR TENDER SPECIFICATION AND S.I.
- (2) TOLERANCE IN WT  $\pm 5\%$
- (3) GENERAL TOLERANCE AS PER IS 2486 (PART I) 1993 T<sub>1</sub> DIMENSIONS UPTO AND INCLUDING 35 MM  $\pm 0.1$  OVER 35 MM  $\pm 0.2$
- (4) BREAKING STRENGTH OF THE CLAMP 3000

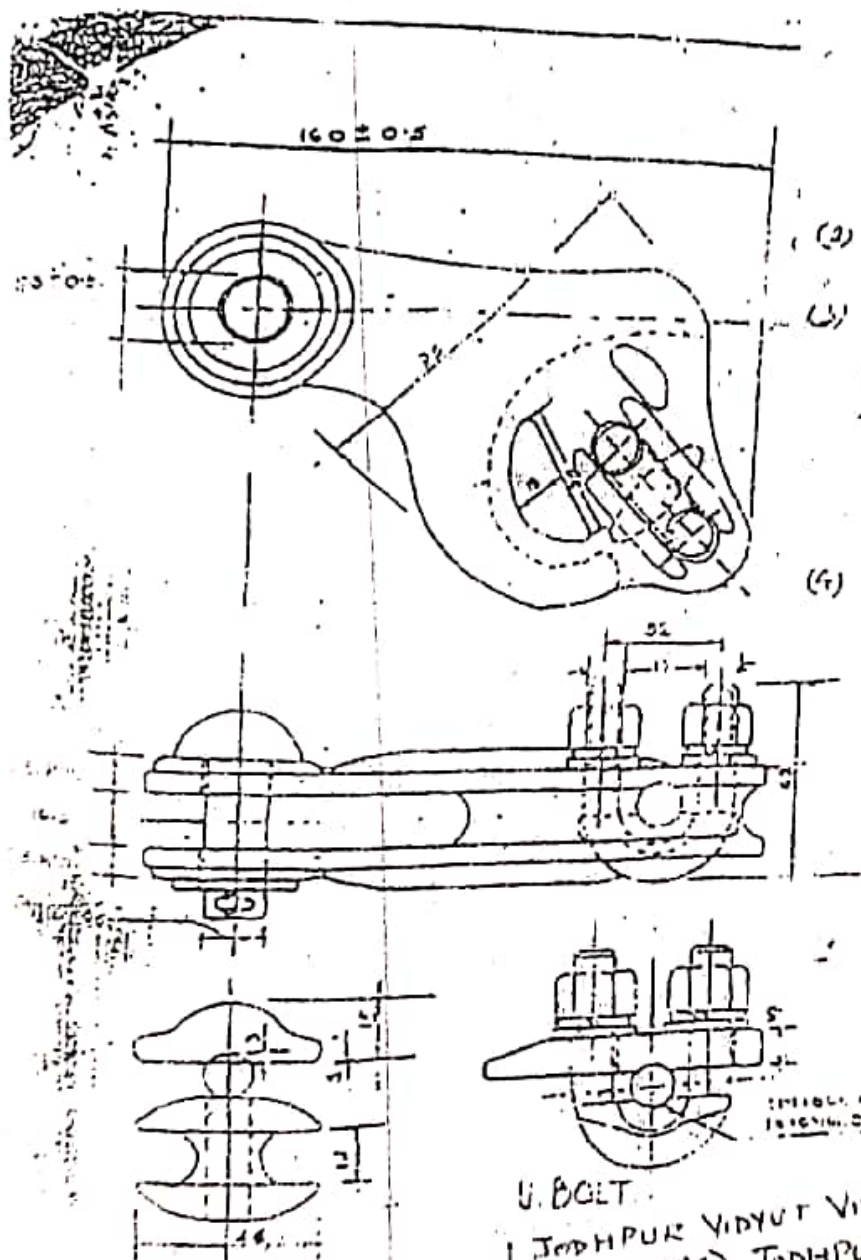

FIXING PIECE


APPENDIX - I (A)  
TN - 1732

U. BOLT  
JODHPUR VIDYUT VITRAN NIGAM LIMITED  
S.E (COMM/EC), JODHPUR  
11KV Strain Clamp of H/W fitting IS.  
11KV Disc Insulator (T.H.) Type

NOTE :-

- ① B.M.C. MATERIAL AS PER OUR TENDER NOTIFICATION AND G.T.P.
- ② GENERAL TOLERANCE AS PER IS: 2046 (PART-1) 1993  
 DIMENSIONS UP TO AND INCLUDING 35MM TOLERANCE  $\pm 0.2$  MM.  
 OVER 35MM  $\pm 2\%$
- ③ TOLERANCE IN WT:  $\pm 5\%$

16/5/2017 I. (C)  
 TN: 1232

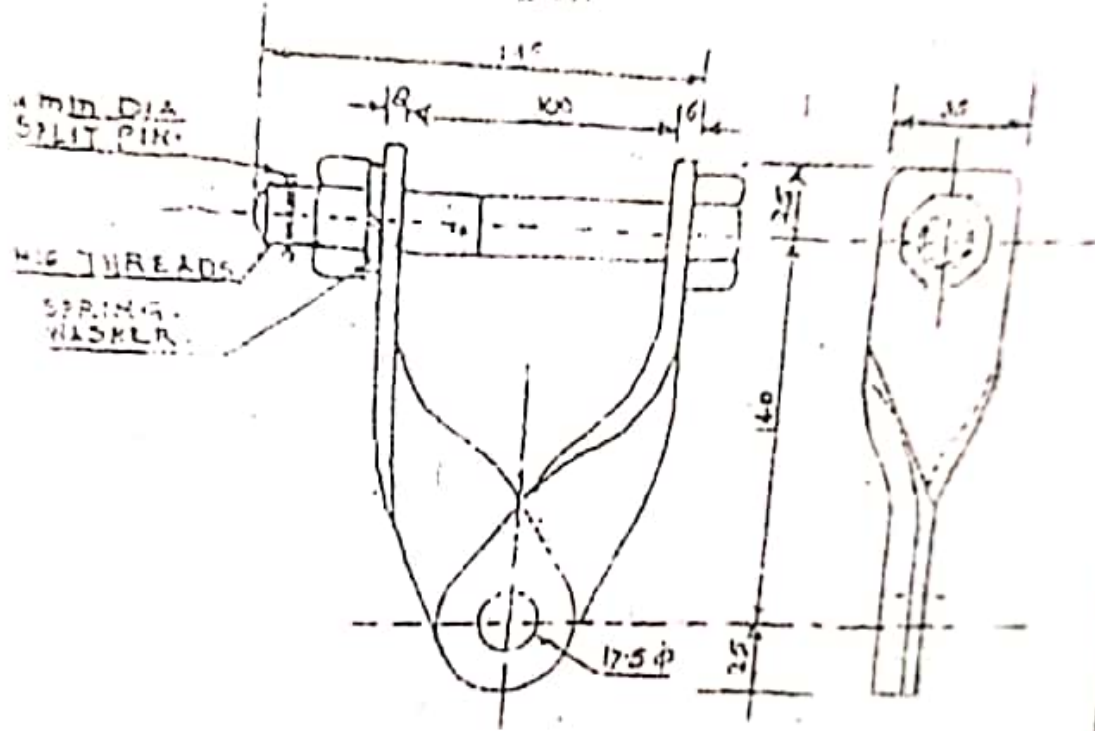


CROSS-ARM STRAPS

ALL DIMENSIONS ARE IN MM

JODHPUR VIDYUT VITRAN NIGAM LIMITED  
 SECMM (S), JODHPUR


Cross Arm Straps for 11KV TDS and  
 B.S Hardware fittings.

SOCKET TONGUE  
W/ TONGUE HOLDER

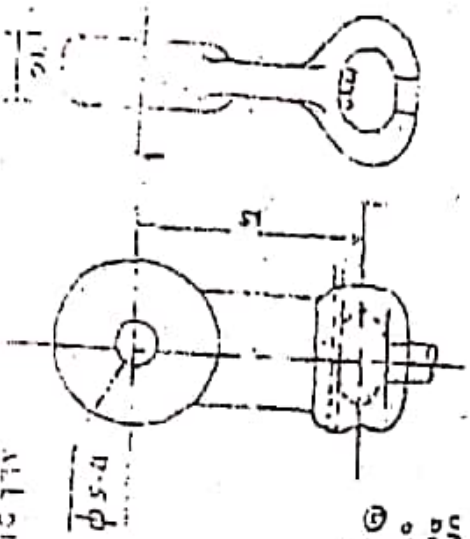

ALL DIMENSIONS  
ARE IN MM


STRAIN CLAMP

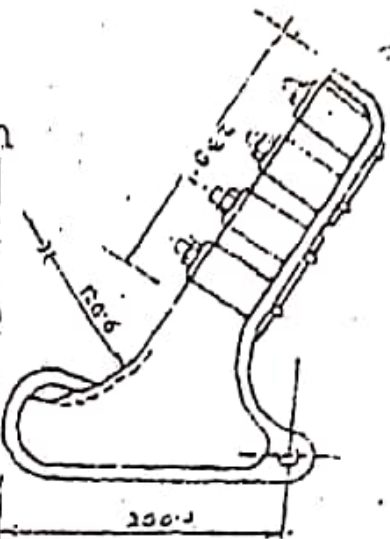


NOTE:-

- ① DIAL OF INTERNAL AS PER  
OUR TENDER SPECIFICATION  
TREN AND G.M.P.
- ② TOLERANCE IN WT ± 5%
- ③ DISCREPANCY IN PER IS: 2108 (PARTS)  
1955

MINIMUM:  
UPR ANGLE -  
RING STRENGTH  
OVER 38MM ± 1.2%  
④ SKENKIN STRENGTH  
OF THE CLAMP - 4500 kg



BALL EYE

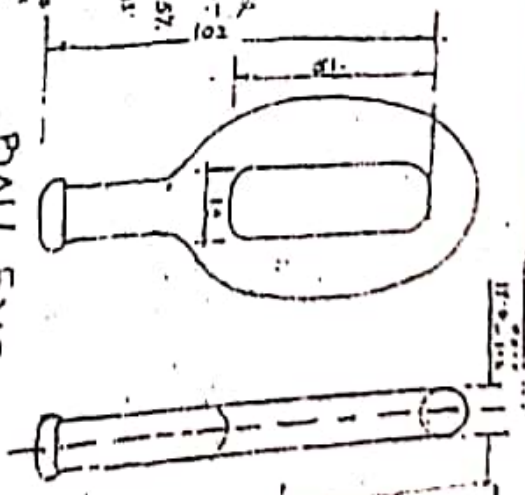

TADHPUR VIDYUT NITRAN NIGAM LIMITED  
SECUMAGS, TADHPUR

44 KV Disc Insulator H/W Fitting  
4.5KN B.S.S TYPE

Appendix 1  
I (B)

TN-

1452